





GROUNDING SYSTEM  
FOR  
PF-1 & P.2.2.3.  
SHEET 20.

ATT. "H"

① can be Routed in conduit  
WITH ASSOCIATED Power  
Feeders.

NOTE: ALL ground leads to  
HMM& PVC COVERING.

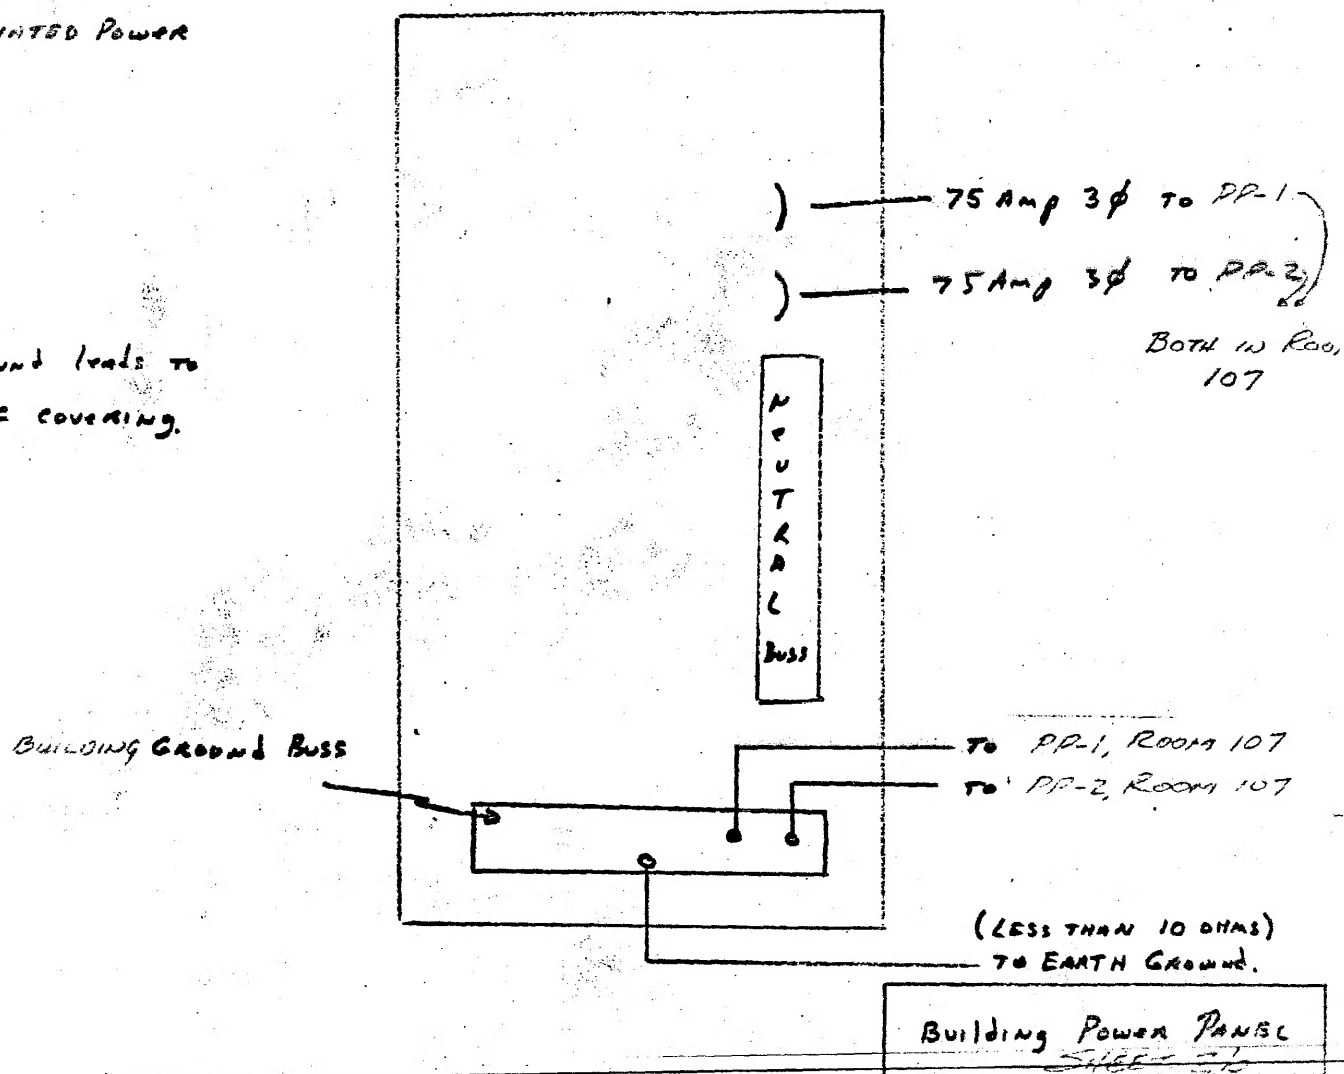

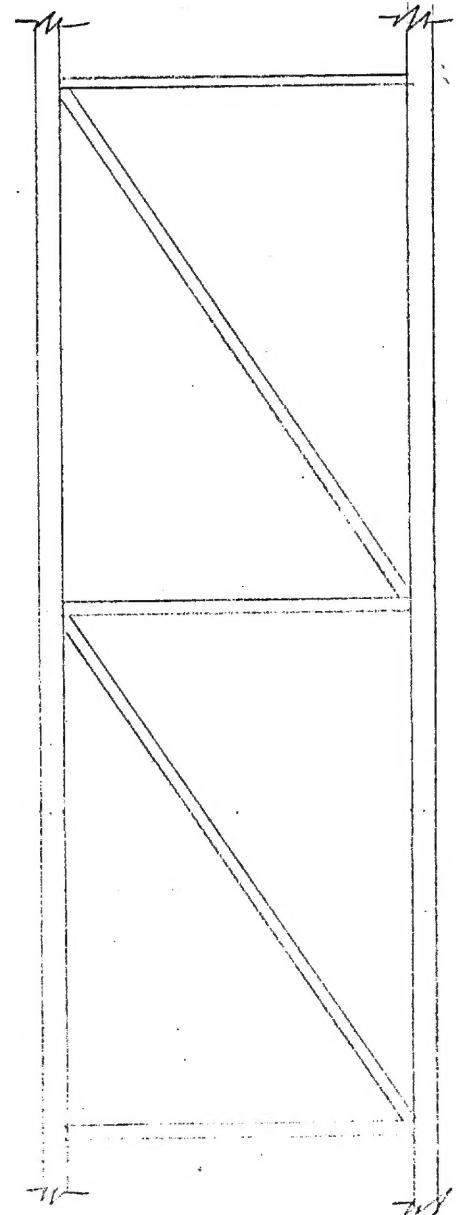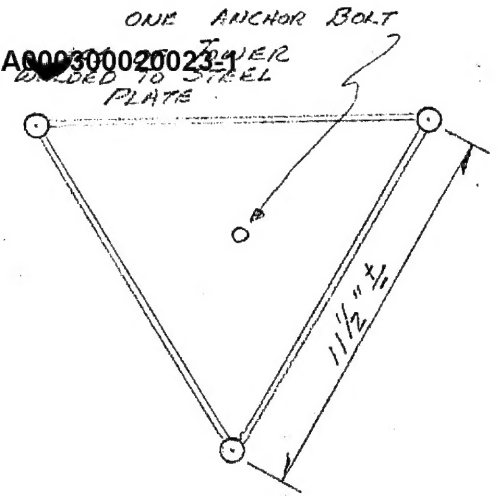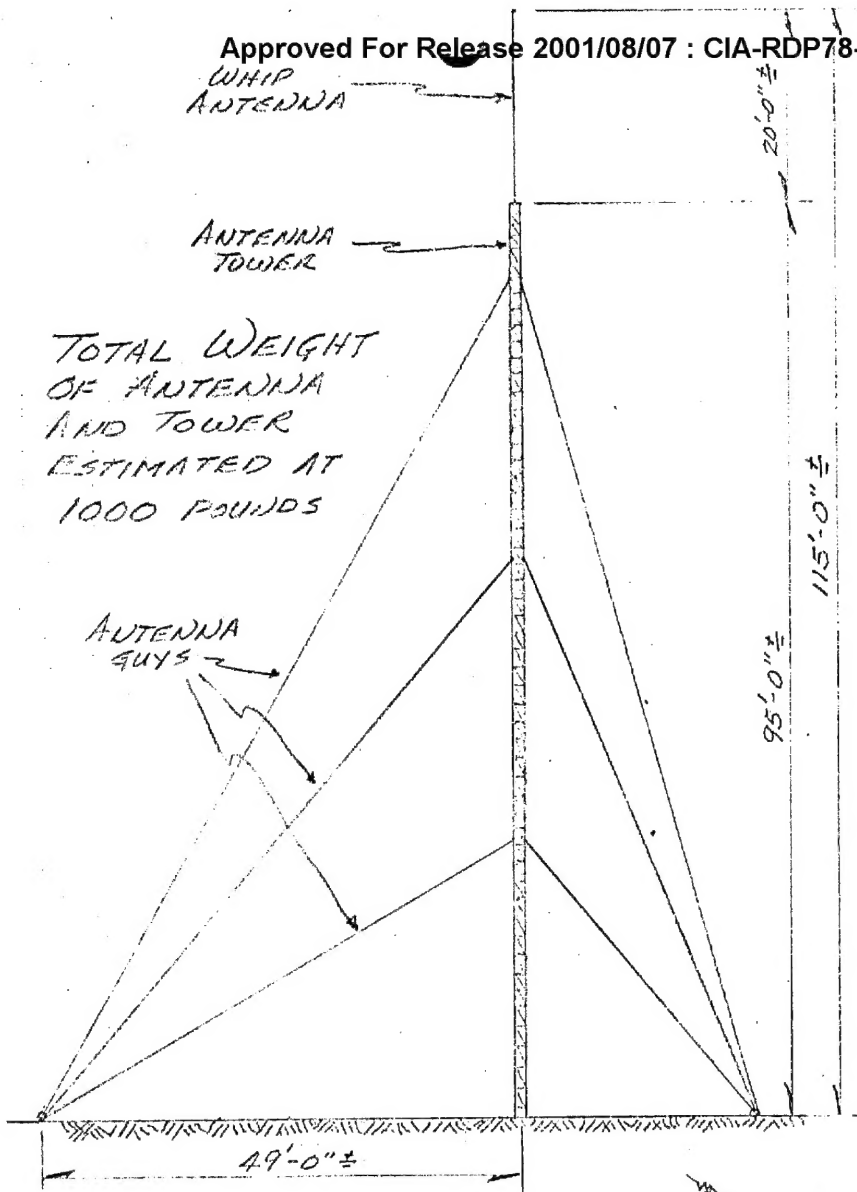

25X1B

Approved For Release 2001/08/07 : CIA-RDP78-06501A000300020023-1

**Next 2 Page(s) In Document Exempt**

Approved For Release 2001/08/07 : CIA-RDP78-06501A000300020023-1